



ENGINEERING STRUCTURAL CALCULATIONS

For


Gillette 78" Frame Genset

September 8, 2016

78" Frame Genset Models:

PR-350	SP-520
PR-550	SP-620
SP-410	SPJD-600

Designed with reference from: 2014 Florida Building Code 5th Edition with 2016 Supplements
ASCE 7 - Minimum Design Loads for Buildings and Other Structures
2005 Aluminum Association Design Manual
ANSI/AISC 360-05 Specifications for Structural Steel Buildings

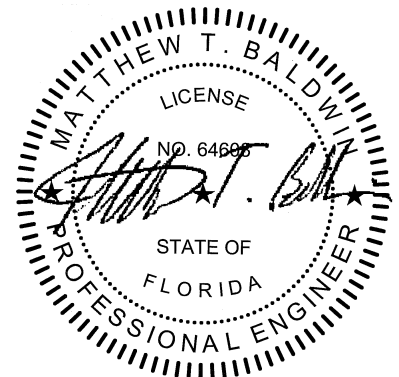

Matthew T. Baldwin, P.E.
Florida License #64608

Project Information

Project Name/Model # - Gillette 68" Frame Genset
Project Number -
 Project Description - 180mph Windload Calculations
 Project Location -
 Customer -
 Mounting Location - Ground

Enclosure Materials

Roof Panels - 0.080 Aluminum Panel - 5052-H34
 Wall Panels - 0.062 Aluminum Panel - 5052-H34

Components

GenSet Manufacturer - Gillette Generators, Inc.
 GenSet Size and Model - 68" Frame
 Base - Bent Aluminum Frame


Supported by - Base

Fasteners/Hardware

	Bolt Size	Grade/Finish
Panels	5/16" - 18	Grade 18-8/SS
Enclosure to Base	5/16" - 18	Grade 18-8/SS

Specification Requirements

Wind Speed - 180 mph (Greater of Design or Site)
 Exposure Category - D

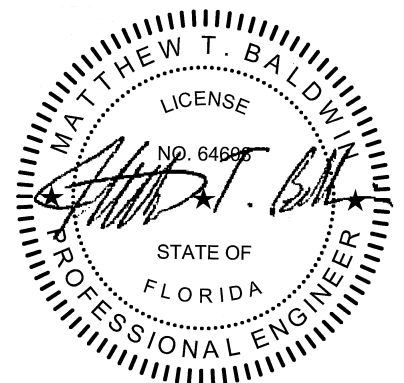

Matthew T. Baldwin, P.E.
 Florida License #64608


Enclosure Dimensions & Component Weights

Gillette 78" Frame Genset

Roof Style- Flat

Enclosure Dimensions (ft)


Wall	Length (ft)		Height (ft)
1	3.5	x	4.15
2	3.5	x	4.15
3	7.84	x	4.15
4	7.84	x	4.15



Plan

Base Dimensions

Width (Wall 1/2 Side)	=	42	in
Length (Wall 3/4 Side)	=	78	in
Height	=	4	in



Elevation

Roof/Eave Information

Roof Pitch Angle - (θ)	=	0.0	Degrees
Eave/Roof Height - h	=	4.15	


Structure Areas

Walls 1/2 Area - $(w1)$	=	14.5	ft ²	=	2,092	in ²
Walls 3/4 Area - $(w3)$	=	32.5	ft ²	=	4,685	in ²
Roof Area - (R)	=	27.4	ft ²	=	3,951	in ²

Base Side 1/2	$(T1)$	=	168.0	in2
Base Side 3/4	$(T3)$	=	312.0	in2

Component Weights

Genset	=	0	lbs	(Varies, so will use zero to be conservative/most uplift to resist)
Enclosure	=	150	lbs	(Based on Aluminum to be conservative/most uplift to resist)
Base Frame	=	100	lbs	(Based on Aluminum to be conservative/most uplift to resist)

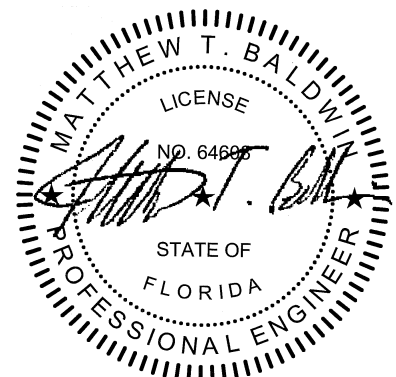

Matthew T. Baldwin, P.E.
Florida License #64608


MWFRS Net Pressures

Gillette 78" Frame Genset

Wind

Directional Procedure method from ASCE 7 are utilized in these calculations.


Enclosure Classification	-	Enclosed
Exposure Category	-	D
Basic Wind Speed	(V)	180 mph
Wind Directionality Factors	(K _d)	0.85
Internal Pressure Coefficients	(GC _{pi})	± 0.18
Velocity Pressure Exposure Coefficient	(K _z)	1.03
Roof Mean Height Above Ground Level	(z)	4.48 ft
Velocity Pressure	(q)	72.63 psf

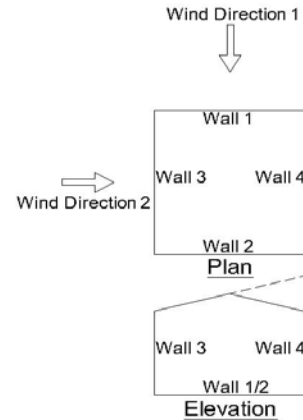

Wind Direction 1										
	Enclosure									
	Wall #			Roof						
	1	2	3&4	Parallel to Ridge					(C _p)2	
	Windward	Leeward	Side	(C _p)1 (Distance From Windward Edge)						
			0 to 2.1	2.1 to 4.2	4.2 to 7.8					
Background Response Factor (Q)	0.98	0.98	0.97	0.98						
Gust Effect Factors (G)	0.91	0.91	0.91	0.91						
External Pressure Coefficients (C _p)	0.80	-0.288	-0.70	-0.91	-0.89	-0.51			-0.18	
Net Pressures with + (GC _{pi}) - psf (Net _{p+})	40.1	-32.2	-59.4	-73.4	-72.1	-47.1			-25.0	
Net Pressures with - (GC _{pi}) - psf (Net _{p-})	66.2	-6.1	-33.3	-47.3	-45.9	-20.9			1.1	

Wind Direction 2										
	Enclosure									
	Wall #			Roof - Normal To Ridge						
	3	4	1&2	(C _p)1 (Distance From Windward Edge)					(C _p)2	
	Windward	Leeward	Side	0 to 2.1	> 2.1					
Background Response Factor (Q)	0.97	0.97	0.98	0.97						
Gust Effect Factors (G)	0.91	0.91	0.91	0.91						
External Pressure Coefficients (C _p)	0.80	-0.5	-0.70	-1.04	-0.70				-0.18	
Net Pressures with + (GC _{pi}) - psf (Net _{p+})	39.9	-46.2	-59.6	-81.9	-59.4				-25.0	
Net Pressures with - (GC _{pi}) - psf (Net _{p-})	66.0	-20.0	-33.4	-55.8	-33.3				1.2	

Plus and minus signs signify pressures acting toward or away from the surfaces, respectively.

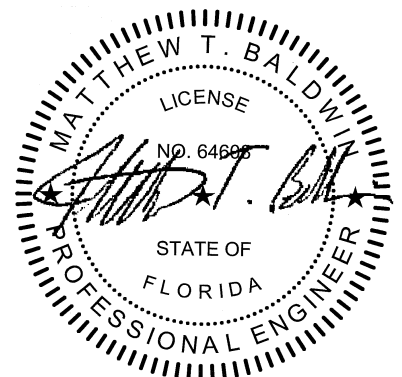

Matthew T. Baldwin, P.E.
Florida License #64608

Structural Calculations - Roof

Gillette 78" Frame Genset

Critical Loads & Pressures

Wind Pressures

Downforce 1.16 psf = 0.01 psi
Uplift -81.91 psf = -0.57 psi

Section Properties

0.080 Aluminum Panel - 5052-H34

Modulus of Elasticity (E) = 1.02E+04 ksi
Safety Factor (n_u) = 1.95
Safety Factor (n_y) = 1.65
Coefficient (k_t) = 1.00
Tensile Ultimate Strength (F_{tu}) = 34 ksi
Tensile Yield Strength (F_{ty}) = 26 ksi
Compressive Yield Strength (F_{cy}) = 24 ksi
Shear Ultimate Strength (F_{su}) = 20 ksi

Entire Roof Uplift Calculations

Roof Area

Area of Roof Subjected to Uplift (R) = 3,951 in²

Roof Uplift Calculated Forces

Wind Load Uplift Force (w_{ru}) = -2,248 lbs

Total Roof Design Uplift (W_{ru}) = ~~-2,248~~ lbs

Mounting Hardware - Roof Frame to Wall Panels

Screws Along Length - 1 Side = 6 5/16" - 18 - Grade 18-8/SS
Screws Along Width - 1 Side = 3 5/16" - 18 - Grade 18-8/SS
Total Mounting Screws = 18 5/16" - 18 - Grade 18-8/SS

Entire Roof Uplift Design Calculations


Grade 18-8/SS = 150,000 psi
5/16" Bolt Nominal Diameter = 0.255 in
5/16" Bolt Effective Area = 0.051 in²
5/16" Bolt Threads per Inch = 18
Washer Nominal Diameter = 0.875 in
Wall Panel Tensile Ult. Strength = 34 ksi
Wall Panel Tensile Yield Strength = 26 ksi
Safety Factor = 3
Wall Panel Nominal Thickness = 0.062 in
Maximum Tensile Strength = 439.2 lbs
Maximum Shear/Bearing Strength = 408.6 lbs
Max. Shear Load per Screw = 408.6 lbs

Max. Total Screws Shear Strength (P_{ts}) = 7,354 lbs

Conclusion

(W_{ru}) 2,248 lbs < (P_{ts}) 7,354 lbs

OK

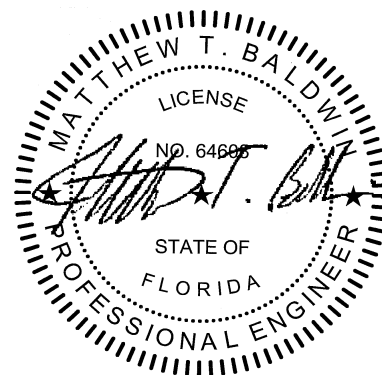

Matthew T. Baldwin, P.E.
Florida License #64608

Roof Panel Uplift Calculations

Roof Panel Critical Member Dimensions

Critical Panel Length $(L_p) = 78$ in
Critical Panel Width $(W_p) = 42$ in

Roof Panel Uplift Calculated Forces

Distributed Loads

Wind Load Uplift Force $(W_{pu}) = 1,863.5$ lbs

Mounting Hardware - Roof Panel to Roof Frame

Screws Along Length - 1 Side = 8 5/16" - 18 - Grade 18-8/SS
Screws Along Width - 1 Side = 4 5/16" - 18 - Grade 18-8/SS

Roof Panel Uplift Design Calculations


Grade 18-8 Ultimate Strength = 150,000 psi
5/16 Bolt Nominal Diameter = 0.255 in
5/16 Bolt Effective Area = 0.051 in²
5/16 SBolt Threads per Inch = 18
Washer Nominal Diameter = 0.875 in
Roof Panel Tensile Ult. Strength = 34 ksi
Roof Panel Tensile Yield Strength = 26 ksi
Safety Factor = 3
Roof Panel Nominal Thickness = 0.080 in

	Roof Frame		
Maximum Tensile Strength	= 439.2	lbs	(Accounts for screw pull-over strength)
Maximum Shear/Bearing Strength	= 408.6	lbs	
Max. Tensile Load per Screw	= 408.6	lbs	

Max. Total Screws Tensile Strength $(P_{ts}) = 9,806$ lbs

Conclusion

(W_{pu}) 1,863 lbs < (P_{ts}) 9,806 lbs **OK**

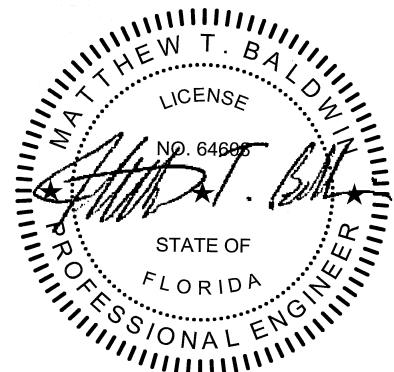

Matthew T. Baldwin, P.E.
Florida License #64608

Structural Calculations - Walls/Columns

Gillette 78" Frame Genset

Critical Wind Load Pressures and Roof Forces

Walls 1 & 2

Maximum Pressures Acting:

$$\begin{aligned} \text{Toward} & 66.2 \text{ psf} & = & 0.4598 \text{ psi} \\ \text{Away} & -59.6 \text{ psf} & = & -0.4137 \text{ psi} \end{aligned}$$

Walls 3 & 4

Maximum Pressures Acting:

$$\begin{aligned} \text{Toward} & 66.0 \text{ psf} & = & 0.4585 \text{ psi} \\ \text{Away} & -59.4 \text{ psf} & = & -0.4125 \text{ psi} \end{aligned}$$

Critical Wall Panel Dimensions

$$\begin{aligned} \text{Critical/Maximum Panel Width} & = & 39.5 & \text{ in} \\ \text{Critical/Maximum Panel Height} & = & 48.0 & \text{ in} \end{aligned}$$

Section Properties

0.062 Aluminum Panel - 5052-H34

$$\begin{aligned} \text{Cross Sectional Area} & (A) & = & 2.58 \text{ in}^2 \\ \text{Moment of Inertia - x} & (I_x) & = & 0.05 \text{ in}^4 \\ \text{Section Modulus - x} & (S_x) & = & 0.88 \text{ in}^3 \\ \text{Radius of Gyration - x} & (r_x) & = & 0.14 \text{ in} \\ \text{Modulus of Elasticity} & (E) & = & 1.02\text{E}+04 \text{ ksi} \\ \text{Safety Factor} & (n_u) & = & 1.95 \\ \text{Factor of Safety} & (n_y) & = & 1.65 \\ \text{Coefficient - Tension Member} & (k_t) & = & 1.0 \\ \text{Tensile Ultimate Strength} & (F_{tu}) & = & 34 \text{ ksi} \\ \text{Tensile Yield Strength} & (F_{ty}) & = & 26 \text{ ksi} \\ \text{Shear Ultimate Strength} & (F_{su}) & = & 20 \text{ ksi} \\ \text{Compressive Yield Strength} & (F_{cy}) & = & 23 \text{ ksi} \end{aligned}$$

Critical Wall Panel Calculated Forces

Maximum Wind Pressure on Walls

$$\begin{aligned} \text{Maximum + Wind Pressure} & = & 0.4598 & \text{ psi} \\ \text{Maximum - Wind Pressure} & = & -0.4137 & \text{ psi} \end{aligned}$$


Plus and minus signs signify pressures acting toward or away from the surfaces, respectively.

Wind Shear Distributed Loads on Critical Panel

$$\begin{aligned} \text{Maximum + Wind Shear} & = & 18.2 & \text{ lbs/in} \\ \text{Maximum - Wind Shear} & = & -16.3 & \text{ lbs/in} \end{aligned}$$

Total Wind Shear on Critical Panel

$$\text{Total Panel Design Shear } (V_{ww}) = 871.8 \text{ lbs}$$

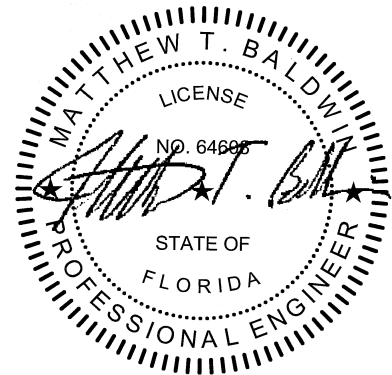

Matthew T. Baldwin, P.E.
Florida License #64608

Critical Panel Roof Load (Roof to Wall)

Axial Roof Load $(W_{wr}) = 0.0$ lbs

Mounting Hardware - Wall Panel to Wall Panel

To be conservative, the 'wall to roof' and 'wall to floor' connections are neglected.

Bolts Along Length - 1 Side = 3 5/16" - 18 - Grade 18-8/SS

Total Mounting Screws = 6 5/16" - 18 - Grade 18-8/SS

Wall Panel Design Calculations


Mounting Hardware - Shear and Tension

Grade 18-8/SS = 150,000 psi
 Grade 18-8/SS Shear Strength = 30,000 psi (Includes Reduction Factor)
 Grade 18-8/SS Tensile Strength = 57,000 psi (Includes Reduction Factor)
 5/16" Bolt Effective Area = 0.0510 in²
 Shear Strength per Bolt = 1,530 lbs
 Tensile Strength per Bolt = 2,907 lbs

Total Bolts Shear Strength $(R_{vb}) = 9,180$ lbs
 Total Bolts Tensile Strength $(R_{tb}) = 17,442$ lbs

Conclusion

(V_{ww}) 872 lbs < (R_{vb}) 9,180 lbs **OK**

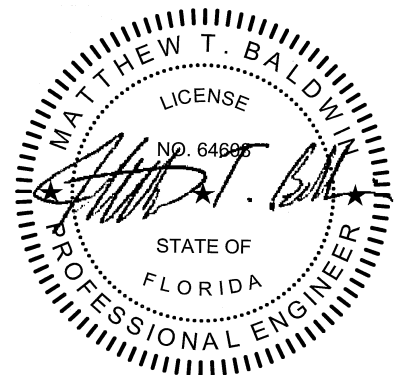

Matthew T. Baldwin, P.E.
Florida License #64608

Structural Calculations - Enclosure to Base

Gillette 78" Frame Genset

Critical Pressures & Loads

To determine maximum moment forces, pressures are algebraically combined relative to toward or away forces (+ & -) and each wind direction.

Wind Direction 1

Net Pressures with + Internal Pressure(+Gcpi)

Walls 1 & 2	-	72.3	psf =	0.5019	psi
Wall 3 or 4	-	59.4	psf =	0.4125	psi
Roof Uplift	-	73.4	psf =	0.5098	psi

Net Pressures with - Internal Pressure(-Gcpi)

Walls 1 & 2	-	72.3	psf =	0.5019	psi
Wall 3 or 4	-	33.3	psf =	0.2310	psi
Roof Uplift	-	47.3	psf =	0.3282	psi

Wind Direction 2

Net Pressures with + Internal Pressure(+Gcpi)

Walls 3 & 4	-	86.0	psf =	0.5975	psi
Wall 1 or 2	-	59.6	psf =	0.4137	psi
Roof Uplift	-	81.9	psf =	0.5688	psi

Net Pressures with - Internal Pressure(-Gcpi)

Walls 3 & 4	-	86.0	psf =	0.5975	psi
Wall 1 or 2	-	33.4	psf =	0.2321	psi
Roof Uplift	-	55.8	psf =	0.3872	psi

Enclosure Critical Dimensions & Weights

Total Enclosure Weight (W_t)	=	150	lbs	(Includes all components)
Walls 1/2 Area	-	(w1)	= 2091.6	in ²
Walls 3/4 Area	-	(w3)	= 4685.2	in ²
Roof Area	-	(R)	= 3951.4	in ²


Enclosure Calculated Forces

Maximum Wind Load Forces on Walls

Wind Direction 1

Net Forces with + Internal Pressure(+Gcpi)

Walls 1/2	-	=	1,050	lbs
Wall 3 or 4	-	=	1,933	lbs
Roof Uplift	-	=	2,014	lbs

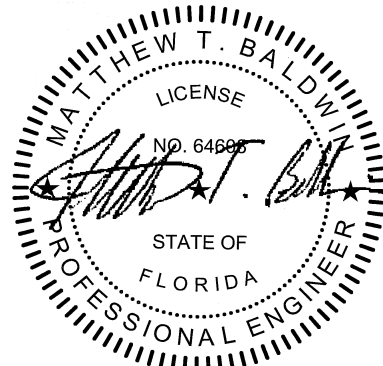

Matthew T. Baldwin, P.E.
Florida License #64608

Net Forces with - Internal Pressure(-Gcpi)

Walls 1/2	-	=	1,050	lbs
Wall 3 or 4	-	=	1,082	lbs
Roof Uplift	-	=	1,297	lbs

Wind Direction 2

Net Forces with + Internal Pressure(+Gcpi)

Walls 3/4	-	=	2,800	lbs
Wall 1 or 2	-	=	865	lbs
Roof Uplift	-	=	2,248	lbs

Net Forces with - Internal Pressure(-Gcpi)

Walls 3/4	-	=	2,800	lbs
Wall 1 or 2	-	=	486	lbs
Roof Uplift	-	=	1,530	lbs

Enclosure Overturn Forces

(Postive forces act upward, negative forces act downward)

Wind Direction 1

Net Forces with + Internal Pressure(+Gcpi)

Overturn on Walls 1/2	=	1,135	lbs
Overturn on Walls 3/4	=	2,003	lbs

Net Forces with - Internal Pressure(-Gcpi)

Overturn on Walls 1/2	=	776	lbs
Overturn on Walls 3/4	=	1,140	lbs

Wind Direction 2

Net Forces with + Internal Pressure(+Gcpi)

Overturn on Walls 3/4	=	2,634	lbs
Overturn on Walls 1/2	=	1,278	lbs

Net Forces with - Internal Pressure(-Gcpi)

Overturn on Walls 3/4	=	2,275	lbs
Overturn on Walls 1/2	=	744	lbs

Design Overturn Force (O_E) = 2,634 lbs Acting On Wall 3/4

Mounting Hardware - Enclosure to Base/Tank or Pad

To be conservative, half the bolt connections along the adjacent walls are neglected.

No. of Bolt Connections Along Wall 3/4 = 6 5/16" - 18 - Grade 18-8/SS

Enclosure Overturn Design Calculations


Grade 18-8 Ultimate Strength	=	150,000	psi
Grade 18-8 Shear Strength	=	30,000	psi (Includes Reduction Factor)
5/16" Bolt Effective Area	=	0.051	in ²
Shear Strength per Bolt	=	1,530	lbs

Total Bolts Shear Strength (R_{vb}) = 9,180 lbs

Conclusion

(O_E) 2,634 lbs < (R_v) 9,180 lbs

OK

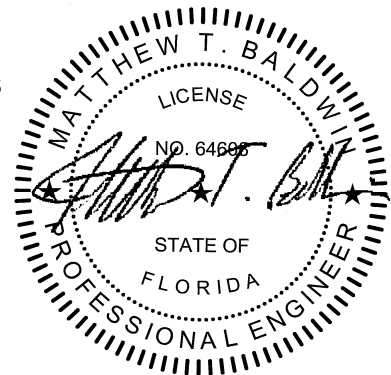

Matthew T. Baldwin, P.E.
Florida License #64608