




ENGINEERING STRUCTURAL CALCULATIONS For Gillette 152" Frame Genset

September 8, 2016

152" Frame Genset Models:

	SPMD-4000	T4D-2500	T4D-6000
PR-1800	SPMD-4500	T4D-3000	
PR-2400	SPMD-5000	T4D-3500	
SP-2650	SPVD-5000	T4D-4000	
SP-3000	SPVD-5500	T4D-5500	
SPMD-3500	SPVD-6000		

Designed with reference from: 2014 Florida Building Code 5th Edition with 2016 Supplements
ASCE 7 - Minimum Design Loads for Buildings and Other Structures
2005 Aluminum Association Design Manual
ANSI/AISC 360-05 Specifications for Structural Steel Buildings

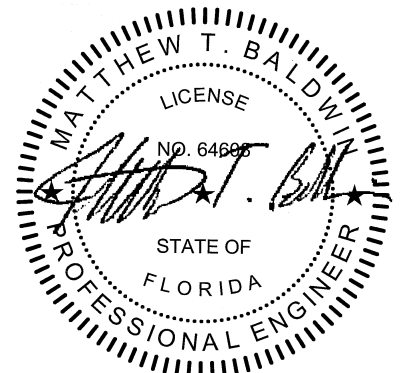

Matthew T. Baldwin, P.E.
Florida License #64608

Project Information

Project Name/Model # - Gillette 152" Frame Genset
Project Number -
 Project Description - 180mph Windload Calculations
 Project Location -
 Customer -
 Mounting Location - Ground

Enclosure Materials

Roof Beam - 11 Gage CRS
 Roof Panels - 0.080 Aluminum Panel - 5052-H34
 Wall Panels - 0.080 Aluminum Panel - 5052-H34

Components

GenSet Manufacturer - Gillette Generators, Inc.
 GenSet Size and Model - 152" Frame
 Base - Bent Aluminum Frame


Supported by - Base

Fasteners/Hardware

	Bolt Size	Grade/Finish
Panels	5/16" - 18	Grade 18-8/SS
Enclosure to Base	5/16" - 18	Grade 18-8/SS

Specification Requirements

Wind Speed - 180 mph (Greater of Design or Site)
 Exposure Category - D

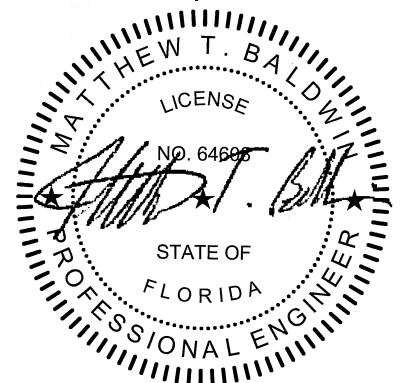

Matthew T. Baldwin, P.E.
 Florida License #64608


Enclosure Dimensions & Component Weights

Gillette 152" Frame Genset

Roof Style- Flat

Enclosure Dimensions (ft)


Wall	Length (ft)		Height (ft)
1	6	x	7.21
2	6	x	7.21
3	16.84	x	7.21
4	16.84	x	7.21



Plan

Base Dimensions

Width (Wall 1/2 Side)	=	72	in
Length (Wall 3/4 Side)	=	152	in
Height	=	8	in



Elevation

Roof/Eave Information

Roof Pitch Angle - (θ)	=	0.0	Degrees
Eave/Roof Height - h	=	7.21	


Structure Areas

Walls 1/2 Area - $(w1)$	=	43.3	ft ²	=	6,229	in ²
Walls 3/4 Area - $(w3)$	=	121.4	ft ²	=	17,484	in ²
Roof Area - (R)	=	101.0	ft ²	=	14,550	in ²

Base Side 1/2	$(T1)$	=	576.0	in ²
Base Side 3/4	$(T3)$	=	1,216.0	in ²

Component Weights

Genset	=	0	lbs	(Varies, so will use zero to be conservative/most uplift to resist)
Enclosure	=	300	lbs	(Based on Aluminum to be conservative/most uplift to resist)
Base Frame	=	250	lbs	(Based on Aluminum to be conservative/most uplift to resist)

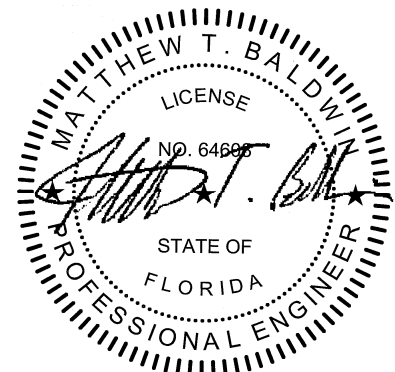

Matthew T. Baldwin, P.E.
Florida License #64608


MWFRS Net Pressures

Gillette 152" Frame Genset

Wind

Directional Procedure method from ASCE 7 are utilized in these calculations.


Enclosure Classification	-	Enclosed
Exposure Category	-	D
Basic Wind Speed	(V)	180 mph
Wind Directionality Factors	(K _d)	0.85
Internal Pressure Coefficients	(GC _{pi})	± 0.18
Velocity Pressure Exposure Coefficient	(K _z)	1.03
Roof Mean Height Above Ground Level	(z)	7.88 ft
Velocity Pressure	(q)	72.63 psf

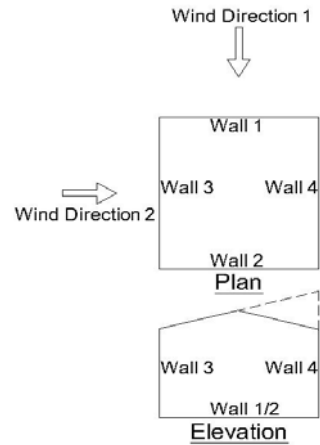

Wind Direction 1									
	Enclosure								
	Wall #			Roof					
	1	2	3&4	Parallel to Ridge					
	Windward	Leeward	Side	(C _p)1 (Distance From Windward Edge)				(C _p)2	
				0 to 3.6	3.6 to 7.2	7.2 to 14.4	> 14.4		
Background Response Factor (Q)	0.97	0.97	0.96	0.97					
Gust Effect Factors (G)	0.91	0.91	0.90	0.91					
External Pressure Coefficients (C _p)	0.80	-0.26	-0.70	-0.90	-0.90	-0.50	-0.3	-0.18	
Net Pressures with + (GC _{pi}) - psf (Net _{p+})	39.8	-30.2	-59.0	-72.6	-72.6	-46.1	-32.9	-25.0	
Net Pressures with - (GC _{pi}) - psf (Net _{p-})	66.0	-4.1	-32.9	-46.4	-46.4	-20.0	-6.8	1.2	

Wind Direction 2									
	Enclosure								
	Wall #			Roof - Normal To Ridge					
	3	4	1&2	(C _p)1 (Distance From Windward Edge)				(C _p)2	
	Windward	Leeward	Side	0 to 3.6	> 3.6				
Background Response Factor (Q)	0.96	0.96	0.97	0.96					
Gust Effect Factors (G)	0.90	0.90	0.91	0.90					
External Pressure Coefficients (C _p)	0.80	-0.5	-0.70	-1.04	-0.70			-0.18	
Net Pressures with + (GC _{pi}) - psf (Net _{p+})	39.5	-45.9	-59.4	-81.4	-59.0			-24.9	
Net Pressures with - (GC _{pi}) - psf (Net _{p-})	65.6	-19.8	-33.2	-55.2	-32.9			1.3	

Plus and minus signs signify pressures acting toward or away from the surfaces, respectively.

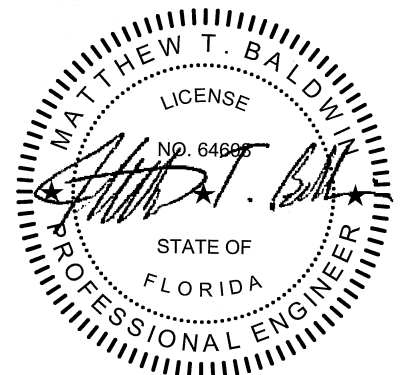

Matthew T. Baldwin, P.E.
Florida License #64608

Structural Calculations - Roof

Gillette 152" Frame Genset

Critical Loads & Pressures

Wind Pressures

Downforce 1.252 psf = 0.01 psi
Uplift -81.38 psf = -0.57 psi

Section Properties

11 Gage CRS

Cross Sectional Area (A) = 0.77 in²
Moment of Inertia - x (I_x) = 0.97 in⁴
Moment of Inertia - y (I_y) = N/A in⁴
Section Modulus - x (S_x) = 0.98 in³
Section Modulus - y (S_y) = N/A in³
Radius of Gyration - x (r_x) = 1.13 in
Radius of Gyration - y (r_y) = N/A in
Polar Moment of Inertia (J) = N/A in⁴
Weight of Beam (ω) = 0.12 lbs/in
Modulus of Elasticity (E) = 2.90E+04 ksi
Safety Factor (n_u) = 1.95
Safety Factor (n_y) = 1.65
Coefficient (k_t) = 1.00
Tensile Ultimate Strength (F_{tu}) = 58 ksi
Tensile Yield Strength (F_{ty}) = 36 ksi
Compressive Yield Strength (F_{cy}) = 22 ksi
Shear Ultimate Strength (F_{su}) = 36 ksi

Roof Frame Calculations

Member Designed for Forces Acting on the [Strong Axis](#)


Interior Beam Critical Member Dimensions

Interior Beam Length (L_i) = 71.75 in
Load Spanned Width (W_i) = 50.72 in

Interior Beam Calculated Forces

Distributed Loads

Weight of Beam (ω) = 0.120 lbs/in
Wind Load Downforce (w_d) = 0.441 lbs/in
Wind Load Uplift Force (w_u) = -28.663 lbs/in

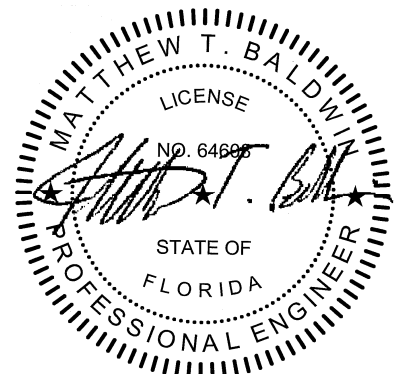

Matthew T. Baldwin, P.E.
Florida License #64608

Shear Forces (Maximum at End)

Beam Weight Shear $(V_b) = 4.31$ lbs
 Wind DownForce Shear $(V_{wd}) = 15.8$ lbs
 Wind Uplift Shear $(V_{wu}) = -1028.3$ lbs

Total Shear Downward = 20.1 lbs
 Total Shear Upward = 1,024.0 lbs

Design Shear $(V_{bi}) = 1024.0$ lbs

Stress Forces (Bending)

Beam Weight Moment $(M_b) = 51$ lb-in
 Wind Downforce Moment $(M_d) = 142$ lb-in
 Wind Uplift Moment $(M_u) = -9,222$ lb-in

Total Moments Downward = 193 lb-in
 Total Moments Upward = 9,171 lb-in

Design Moment $(M_T) = 9,171$ lb-in

Design Stress $(\sigma_{bi}) = 9,358$ psi

Interior Beam Design Calculations

Allowable Shear Strength

Slenderness Limit 1 $(S_1) = -20.08$
 Slenderness Limit 2 $(S_2) = 102.40$
 Slenderness Ratio $(S) = 18.0$

Allowable Shear Stress = 9,856 psi
 Allowable Shear Strength $(V_n) = 7,589$ lbs

Conclusion

(V_{bi}) 1,024 lbs < (V_n) 7,589 lbs **OK**

Allowable Stresses For Tension And Compression (Bending)

Tension

Allowable Tensile Stress $(F_t) = 16,000$ psi

Compression


Slenderness Limit 1 $(S_1) = 25.0$
 Slenderness Limit 2 $(S_2) = 125.0$
 Slenderness Ratio $(S) = 63.5$

Allowable Compressive Stress $(F_c) = 11,149$ psi

The Allowable Compressive Stress is the controlling failure design
 Therefore, $(F_b) = 11,149$ psi

Conclusion

(σ_{bi}) 9,358 psi < (F_b) 11,149 psi **OK**

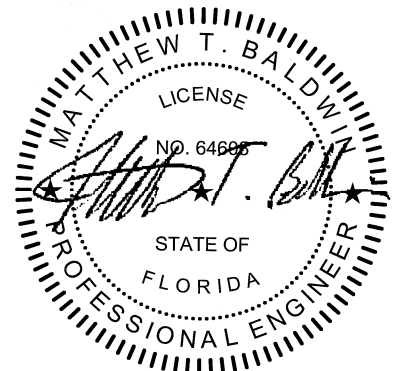

Matthew T. Baldwin, P.E.
 Florida License #64608

Entire Roof Uplift Calculations

Roof Area

Area of Roof Subjected to Uplift $(R) = 14,550 \text{ in}^2$

Roof Uplift Calculated Forces

To be conservative, the weight of the roof frame and panels is neglected.

Weight of Accessories $(\omega_a) = 0 \text{ lbs}$

Wind Load Uplift Force $(W_{ru}) = -8,222 \text{ lbs}$

Total Roof Design Uplift $(W_{ru}) = -4,933 \text{ lbs}$

Mounting Hardware - Roof Frame to Wall Panels

Screws Along Length - 1 Side = 12 5/16" - 18 - Grade 18-8/SS

Screws Along Width - 1 Side = 4 5/16" - 18 - Grade 18-8/SS

Total Mounting Screws = 32 5/16" - 18 - Grade 18-8/SS

Entire Roof Uplift Design Calculations

Grade 18-8 Ultimate Strength = 150,000 psi

5/16 Bolt Nominal Diameter = 0.255 in

5/16 Bolt Effective Area = 0.051 in²

5/16 SBolt Threads per Inch = 18

Washer Nominal Diameter = 0.875 in

Wall Panel Tensile Ult. Strength = 34 ksi

Wall Panel Tensile Yield Strength = 26 ksi

Safety Factor = 3

Wall Panel Nominal Thickness = 0.062 in

Maximum Tensile Strength = 439.2 lbs

Maximum Shear/Bearing Strength = 408.6 lbs

Max. Tensile Load per Screw = 408.6 lbs

Max. Total Screws Tensile Strength $(P_{ts}) = 13,074 \text{ lbs}$

Conclusion

$(W_{ru}) \quad 4,933 \text{ lbs} < (P_{ts}) \quad 13,074 \text{ lbs} \quad \text{OK}$

Roof Panel Uplift Calculations

Roof Panel Critical Member Dimensions

Critical Panel Length $(L_p) = 53.38 \text{ in}$

Critical Panel Width $(W_p) = 72 \text{ in}$

Roof Panel Uplift Calculated Forces


Distributed Loads

Wind Load Uplift Force $(W_{pu}) = 1,303.0 \text{ lbs}$

Mounting Hardware - Roof Panel to Roof Frame

Screws Along Length - 1 Side = 4 5/16" - 18 - Grade 18-8/SS

Screws Along Width - 1 Side = 4 5/16" - 18 - Grade 18-8/SS

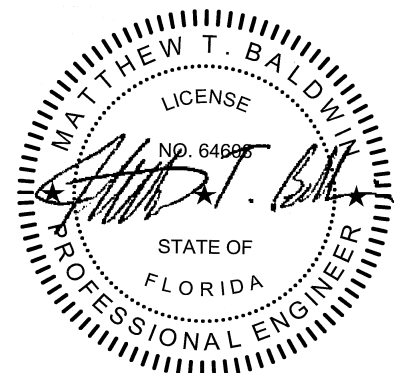

Matthew T. Baldwin, P.E.
Florida License #64608

Roof Panel Uplift Design Calculations


Grade 410 Ultimate Strength = 150,000 psi
5/16 Bolt Nominal Diameter = 0.255 in
5/16 Bolt Effective Area = 0.051 in²
5/16 Bolt Threads per Inch = 18
Washer Nominal Diameter = 0.875 in
Roof Panel Tensile Ult. Strength = 34 ksi
Roof Panel Tensile Yield Strength = 26 ksi
Safety Factor = 3
Roof Panel Nominal Thickness = 0.080 in

	Roof Frame		
Maximum Tensile Strength =	439.2	lbs	(Accounts for screw pull-over strength)
Maximum Shear/Bearing Strength =	408.6	lbs	
Max. Tensile Load per Screw =	408.6	lbs	

Max. Total Screws Tensile Strength (P_{ts}) = 6,537 lbs

Conclusion

(w_{pu}) 1,303 lbs < (P_{ts}) 6,537 lbs **OK**

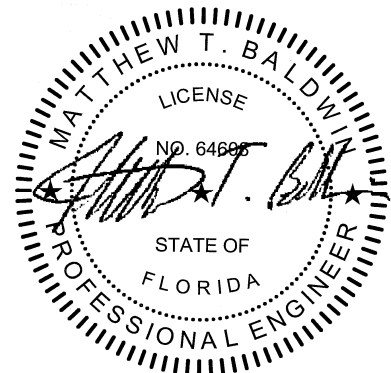

Matthew T. Baldwin, P.E.
Florida License #64608

Structural Calculations - Walls/Columns

Gillette 152" Frame Genset

Critical Wind Load Pressures and Roof Forces

Walls 1 & 2

Maximum Pressures Acting:

$$\begin{aligned} \text{Toward} & 66.0 \text{ psf} & = & 0.4582 \text{ psi} \\ \text{Away} & -59.4 \text{ psf} & = & -0.4123 \text{ psi} \end{aligned}$$

Walls 3 & 4

Maximum Pressures Acting:

$$\begin{aligned} \text{Toward} & 65.6 \text{ psf} & = & 0.4557 \text{ psi} \\ \text{Away} & -59.0 \text{ psf} & = & -0.4100 \text{ psi} \end{aligned}$$

Critical Wall Panel Dimensions

$$\begin{aligned} \text{Critical/Maximum Panel Width} & = & 68 & \text{ in} \\ \text{Critical/Maximum Panel Height} & = & 70.0 & \text{ in} \end{aligned}$$

Section Properties

0.080 Aluminum Panel - 5052-H34

$$\begin{aligned} \text{Cross Sectional Area} & (A) & = & 3.79 \text{ in}^2 \\ \text{Moment of Inertia - x} & (I_x) & = & 0.05 \text{ in}^4 \\ \text{Section Modulus - x} & (S_x) & = & 0.80 \text{ in}^3 \\ \text{Radius of Gyration - x} & (r_x) & = & 0.11 \text{ in} \\ \text{Modulus of Elasticity} & (E) & = & 1.02\text{E}+04 \text{ ksi} \\ \text{Safety Factor} & (n_u) & = & 1.95 \\ \text{Factor of Safety} & (n_y) & = & 1.65 \\ \text{Coefficient - Tension Member} & (k_t) & = & 1.0 \\ \text{Tensile Ultimate Strength} & (F_{tu}) & = & 34 \text{ ksi} \\ \text{Tensile Yield Strength} & (F_{ty}) & = & 26 \text{ ksi} \\ \text{Shear Ultimate Strength} & (F_{su}) & = & 20 \text{ ksi} \\ \text{Compressive Yield Strength} & (F_{cy}) & = & 24 \text{ ksi} \end{aligned}$$

Critical Wall Panel Calculated Forces

Maximum Wind Pressure on Walls

$$\begin{aligned} \text{Maximum + Wind Pressure} & = & 0.4582 & \text{ psi} \\ \text{Maximum - Wind Pressure} & = & -0.4123 & \text{ psi} \end{aligned}$$


Plus and minus signs signify pressures acting toward or away from the surfaces, respectively.

Wind Shear Distributed Loads on Critical Panel

$$\begin{aligned} \text{Maximum + Wind Shear} & = & 31.2 & \text{ lbs/in} \\ \text{Maximum - Wind Shear} & = & -28.0 & \text{ lbs/in} \end{aligned}$$

Total Wind Shear on Critical Panel

$$\text{Total Panel Design Shear } (V_{ww}) = 2,180.9 \text{ lbs}$$

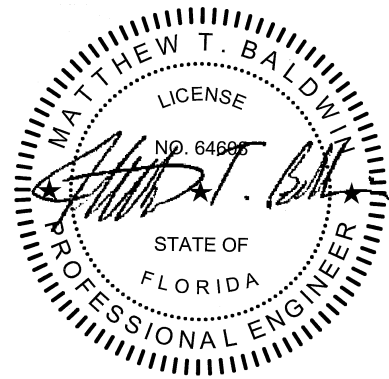

Matthew T. Baldwin, P.E.
Florida License #64608

Critical Panel Roof Load (Roof to Wall)

Axial Roof Load $(W_{wr}) = 0.0$ lbs

Mounting Hardware - Wall Panel to Wall Panel

To be conservative, the 'wall to roof' and 'wall to floor' connections are neglected.

Bolts Along Length - 1 Side = 4 5/16" - 18 - Grade 18-8/SS

Total Mounting Screws = 8 5/16" - 18 - Grade 18-8/SS

Wall Panel Design Calculations

Mounting Hardware - Shear and Tension


Grade 18-8/SS = 150,000 psi
 Grade 18-8/SS Shear Strength = 30,000 psi (Includes Reduction Factor)
 Grade 18-8/SS Tensile Strength = 57,000 psi (Includes Reduction Factor)
 5/16" Bolt Effective Area = 0.0510 in²
 Shear Strength per Bolt = 1,530 lbs
 Tensile Strength per Bolt = 2,907 lbs

Total Bolts Shear Strength $(R_{vb}) = 12,240$ lbs

Total Bolts Tensile Strength $(R_{tb}) = 23,256$ lbs

Conclusion

(V_{ww}) 2,181 lbs < (R_{vb}) 12,240 lbs **OK**

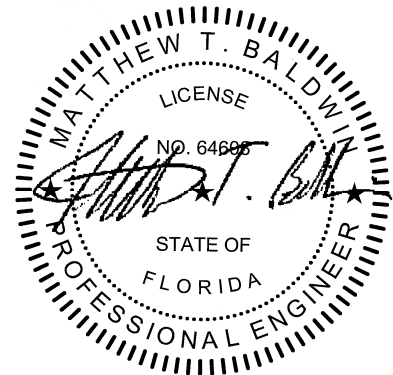

Matthew T. Baldwin, P.E.
 Florida License #64608

Structural Calculations - Enclosure to Base/Tank or Pad

Gillette 152" Frame Genset

Critical Pressures & Loads

To determine maximum moment forces, pressures are algebraically combined relative to toward or away forces (+ & -) and each wind direction.

Wind Direction 1

Net Pressures with + Internal Pressure(+Gcpi)

Walls 1 & 2 -	70.1	psf =	0.4866	psi
Wall 3 or 4 -	59.0	psf =	0.4100	psi
Roof Uplift -	72.6	psf =	0.5041	psi

Net Pressures with - Internal Pressure(-Gcpi)

Walls 1 & 2 -	70.1	psf =	0.4866	psi
Wall 3 or 4 -	32.9	psf =	0.2285	psi
Roof Uplift -	46.4	psf =	0.3225	psi

Wind Direction 2

Net Pressures with + Internal Pressure(+Gcpi)

Walls 3 & 4 -	85.4	psf =	0.5929	psi
Wall 1 or 2 -	59.4	psf =	0.4123	psi
Roof Uplift -	81.4	psf =	0.5651	psi

Net Pressures with - Internal Pressure(-Gcpi)

Walls 3 & 4 -	85.4	psf =	0.5929	psi
Wall 1 or 2 -	33.2	psf =	0.2307	psi
Roof Uplift -	55.2	psf =	0.3835	psi

Enclosure Critical Dimensions & Weights

Total Enclosure Weight (W_t) =	300	lbs	(Includes all components)
Walls 1/2 Area - ($w1$) =	6229.4	in ²	
Walls 3/4 Area - ($w3$) =	17484.0	in ²	
Roof Area - (R) =	14549.8	in ²	


Enclosure Calculated Forces

Maximum Wind Load Forces on Walls

Wind Direction 1

Net Forces with + Internal Pressure(+Gcpi)

Walls 1/2 -	=	3,031	lbs
Wall 3 or 4 -	=	7,169	lbs
Roof Uplift -	=	7,335	lbs

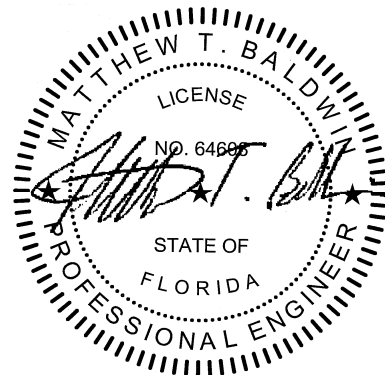

Matthew T. Baldwin, P.E.
Florida License #64608

Net Forces with - Internal Pressure(-Gcpi)

Walls 1/2	-	=	3,031	lbs
Wall 3 or 4	-	=	3,994	lbs
Roof Uplift	-	=	4,693	lbs

Wind Direction 2

Net Forces with + Internal Pressure(+Gcpi)

Walls 3/4	-	=	10,366	lbs
Wall 1 or 2	-	=	2,568	lbs
Roof Uplift	-	=	8,222	lbs

Net Forces with - Internal Pressure(-Gcpi)

Walls 3/4	-	=	10,366	lbs
Wall 1 or 2	-	=	1,437	lbs
Roof Uplift	-	=	5,580	lbs

Enclosure Overturn Forces

(Postive forces act upward, negative forces act downward)

Wind Direction 1

Net Forces with + Internal Pressure(+Gcpi)

Overturn on Walls 1/2	=	2,290	lbs
Overturn on Walls 3/4	=	4,485	lbs

Net Forces with - Internal Pressure(-Gcpi)

Overturn on Walls 1/2	=	1,497	lbs
Overturn on Walls 3/4	=	2,548	lbs

Wind Direction 2

Net Forces with + Internal Pressure(+Gcpi)

Overturn on Walls 3/4	=	5,904	lbs
Overturn on Walls 1/2	=	2,647	lbs

Net Forces with - Internal Pressure(-Gcpi)

Overturn on Walls 3/4	=	5,111	lbs
Overturn on Walls 1/2	=	1,559	lbs

Design Overturn Force (O_E) = 5,904 lbs Acting On Wall 3/4

Mounting Hardware - Enclosure to Base/Tank or Pad

To be conservative, half the bolt connections along the adjacent walls are neglected.

No. of Bolt Connections Along Wall 3/4 = 8 5/16" - 18 - Grade 18-8/SS

Enclosure Overturn Design Calculations


Grade 18-8 Ultimate Strength	=	150,000	psi
Grade 18-8 Shear Strength	=	30,000	psi (Includes Reduction Factor)
5/16" Bolt Effective Area	=	0.051	in ²
Shear Strength per Bolt	=	1,530	lbs

Total Bolts Shear Strength (R_{vb}) = 12,240 lbs

Conclusion

(O_E) 5,904 lbs < (R_v) 12,240 lbs

OK

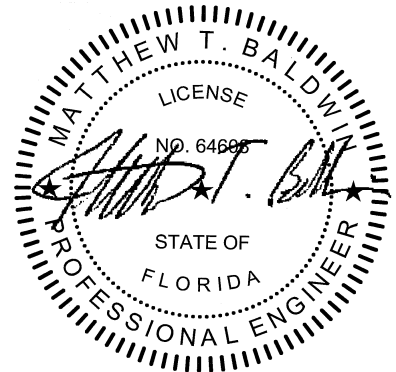

Matthew T. Baldwin, P.E.
Florida License #64608