



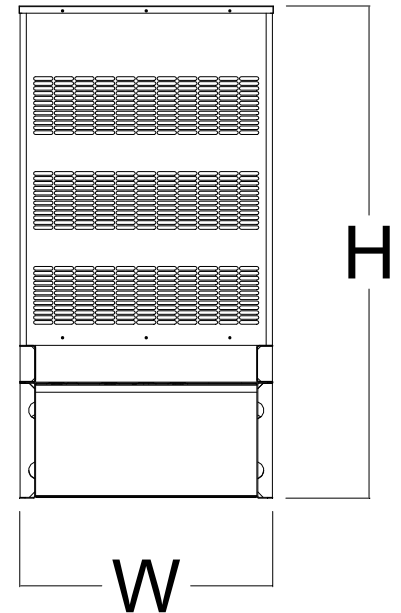

GILLETTE GENERATORS

GEN-SET MOUNTED
ON DOUBLE WALL
SUB-BASE FUEL TANK

SPD-1500 LEVEL 2 & 3 ENCLOSURE

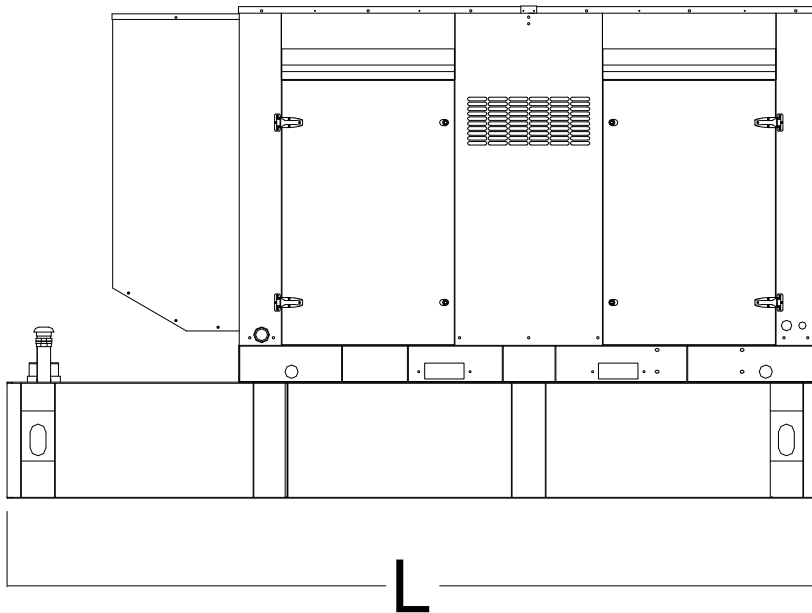

| RUN TIME HOURS | USABLE CAPACITY | | L | W | H | STUB UP | WT. |
|----------------|-----------------|------|-----|----|-----|------------|------|
| | GAL. | LTR. | | | | | |
| NO TANK | - | - | 134 | 48 | 72 | - | 4729 |
| 24 | 266 | 1006 | 154 | 48 | 88 | 24 | 6452 |
| 48 | 533 | 2017 | 154 | 48 | 100 | 24 | 6987 |
| 72 | 799 | 3024 | 216 | 48 | 102 | 24 | 7873 |