



**ENGINEERING STRUCTURAL CALCULATIONS
For
Gillette 280" Frame Gensets**

May 20, 2025

280" LG Frame Genset Models

Location: Florida

**Designed in compliance with: 2023 Florida Building Code, 8th Edition
ASCE 7 - 22 Minimum Design Loads for Buildings and Other Structures
2020 Aluminum Association Design Manual
ANSI/AISC 360-22 - Specification for Structural Steel Buildings**

Anchoring: 1/2" Bolt/Anchors - Minimum (6) per side (12) total

Project Information

Project Name/Model # - Gillette 280" Frame Gensets
Project Number -
Project Description - Sound Attenuated Generator Enclosure
Project Location - Florida
Customer -
Mounting Location - Ground

Enclosure Materials

Roof Beam - 11 Gauge CRS
Roof Panels - 0.102 Aluminum Panel - 5052-H34
Wall Panels - 0.102 Aluminum Panel - 5052-H34
Base Frame/Skid - Formed Aluminum/Steel 'C' Channel

Components

GenSet Manufacturer - Gillette
GenSet Size and Model - 280" Frame Gensets

Supported by - Base


Base - Formed Aluminum/Steel 'C' Channel

Fasteners/Hardware

| | Bolt Size | Washer | Nut | Grade/Finish |
|-------------------|-------------------------|--------------|----------|---------------|
| Roof to Walls | - 5/16" - 18 Bolts | 5/16" Washer | Nut Clip | Grade 18-8/SS |
| Wall to Wall | - 5/16" - 18 Bolts | 5/16" Washer | Nut Clip | Grade 18-8/SS |
| Walls to Base | - 5/16" - 18 Bolts | 5/16" Washer | Nut Clip | Grade 18-8/SS |
| Base to Slab/Tank | - 1/2" Set Bolt Anchors | Flat Washers | Hex Nuts | Grade 5/Galv. |

Specification Requirements

Wind Speed - 200 mph
Exposure Category - D
Risk Category - III
Ground Snow Load (P_g Fig 7.1) - 0 psf
Ice Thickness (t Fig 10-2 to 10-6) - 0.25 in
and Concurrent Wind Gust (V_c) - 30 mph
Seismic Site Class - B

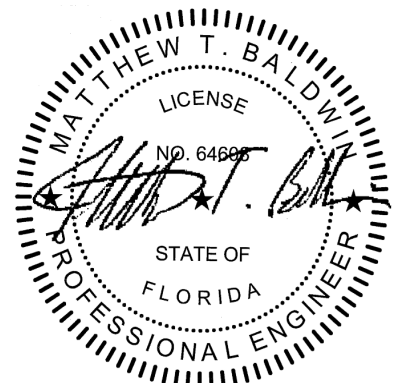

Matthew T. Baldwin, P.E.
Florida License #64608

Enclosure Dimensions & Component Weights

Gillette 280" Frame Gensets

Roof Style- Flat

Enclosure Dimensions (ft)


| Wall | Length (ft) | | Height (ft) |
|------|-------------|---|-------------|
| 1 | 8 | x | 9.4 |
| 2 | 8 | x | 9.4 |
| 3 | 23.333 | x | 9.4 |
| 4 | 23.333 | x | 9.4 |

Base Dimensions


| | | | |
|------------------------|---|-----|----|
| Width (Wall 1/2 Side) | = | 96 | in |
| Length (Wall 3/4 Side) | = | 280 | in |
| Height | = | 8 | in |

Roof/Eave Information

| | | | | | |
|------------------|---|--------------|---|--------|---------|
| Roof Pitch Angle | - | (θ) | = | 0.0 | Degrees |
| Eave/Roof Height | - | h | = | 10.067 | |



Plan




Elevation

Structure Areas

| | | | | | | | | |
|----------------|---|----------|---|---------|-----------------|---|--------|-----------------|
| Walls 1/2 Area | - | ($w1$) | = | 80.5 | ft ² | = | 11,597 | in ² |
| Walls 3/4 Area | - | ($w3$) | = | 234.9 | ft ² | = | 33,824 | in ² |
| Roof Area | - | (R) | = | 186.7 | ft ² | = | 26,880 | in ² |
| Base Side 1/2 | | ($T1$) | = | 768.0 | in | | | |
| Base Side 3/4 | | ($T3$) | = | 2,240.0 | in | | | |

Component Weights (lightest setup for worst case)

| | | | | |
|-----------|---|-------|-----|---|
| Genset | = | 7,500 | lbs | (conserative/most uplift to resist) |
| Enclosure | = | 1,000 | lbs | (Based on Aluminum to be conserative/most uplift to resist) |
| Base | = | 450 | lbs | (Based on Aluminum to be conserative/most uplift to resist) |

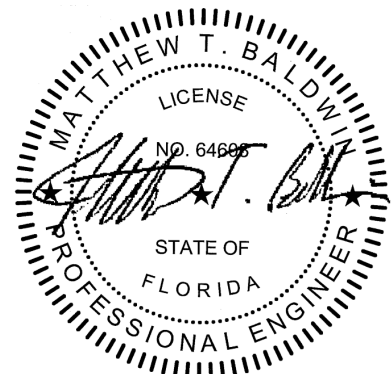

Matthew T. Baldwin, P.E.
Florida License #64608


MWFRS Net Pressures

Gillette 280" Frame Gensets

Wind

Analytical Procedure method and Load Combinations from ASCE 7 are utilized in these calculations.

| | | |
|--|---------------------|------------|
| Enclosure Classification | - | Enclosed |
| Exposure Category | - | D |
| Basic Wind Speed | (V) | 200 mph |
| Importance Factor (Wind) | (I _w) | 1.15 |
| Wind Directionality Factors | (K _d) | 0.85 |
| Internal Pressure Coefficients | (GC _{pi}) | ± 0.18 |
| Velocity Pressure Exposure Coefficient | (K _z) | 1.03 |
| Roof Mean Height Above Ground Level | (z) | 10.73 ft |
| Velocity Pressure | (q) | 103.12 psf |

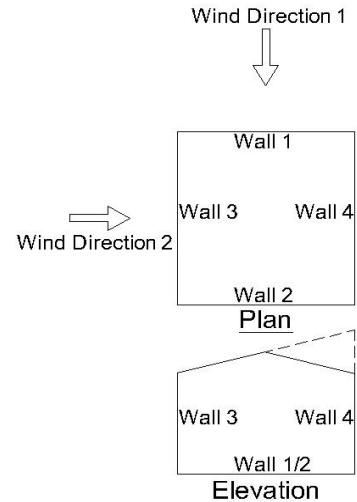


Wind Direction 1

| | Enclosure | | | | | | | |
|---|-----------|---------|-------|--|-------------|--------------|--------|--------------------|
| | Wall # | | | Roof | | | | |
| | 1 | 2 | 3&4 | Parallel to Ridge | | | | |
| | | | | (C _p)1 (Distance From Windward Edge) | | | | (C _p)2 |
| | Windward | Leeward | Side | 0 to 5.0 | 5.0 to 10.1 | 10.1 to 20.1 | > 20.1 | |
| Background Response Factor (Q) | 0.96 | 0.96 | 0.95 | 0.96 | | | | |
| Gust Effect Factors (G) | 0.91 | 0.91 | 0.90 | 0.91 | | | | |
| External Pressure Coefficients (C _p) | 0.80 | -0.254 | -0.70 | -0.90 | -0.90 | -0.50 | -0.3 | -0.18 |
| Net Pressures with + (GC _{pi}) - psf (Net _{p+}) | 56.3 | -42.3 | -83.5 | -102.8 | -102.8 | -65.4 | -46.6 | -35.4 |
| Net Pressures with - (GC _{pi}) - psf (Net _{p-}) | 93.4 | -5.2 | -46.4 | -65.7 | -65.7 | -28.2 | -9.5 | 1.7 |

Wind Direction 2

| | Enclosure | | | | | | | |
|---|-----------|---------|-------|--|-------|--|--|--------------------|
| | Wall # | | | Roof - Normal To Ridge | | | | |
| | 3 | 4 | 1&2 | | | | | |
| | | | | (C _p)1 (Distance From Windward Edge) | | | | (C _p)2 |
| | Windward | Leeward | Side | 0 to 5.0 | > 5.0 | | | |
| Background Response Factor (Q) | 0.95 | 0.95 | 0.96 | 0.95 | | | | |
| Gust Effect Factors (G) | 0.90 | 0.90 | 0.91 | 0.90 | | | | |
| External Pressure Coefficients (C _p) | 0.80 | -0.5 | -0.70 | -1.04 | -0.70 | | | -0.18 |
| Net Pressures with + (GC _{pi}) - psf (Net _{p+}) | 55.7 | -65.0 | -84.1 | -115.1 | -83.5 | | | -35.3 |
| Net Pressures with - (GC _{pi}) - psf (Net _{p-}) | 92.8 | -27.8 | -46.9 | -77.9 | -46.4 | | | 1.9 |

Plus and minus signs signify pressures acting toward or away from the surfaces, respectively.

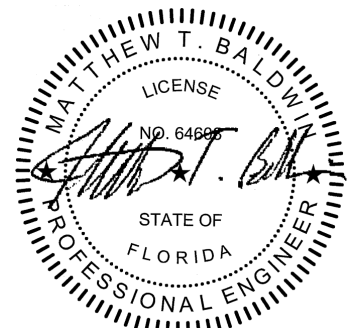

Matthew T. Baldwin, P.E.
Florida License #64608

Snow

| | | |
|--------------------------|---------|-----|
| Importance Factor (Snow) | (I_s) | 1.1 |
| Exposure Factor | (C_e) | 0.8 |
| Thermal Factor | (C_t) | 1.2 |
| Slope Factor | (C_s) | 1.0 |


Flat Roof Snow Load (p_s) 0 psf

Seismic

| | | | |
|--------------------------------------|--------------|---------|-----------------------------|
| Importance Factor (Seismic) | (I_{sm}) | 1.25 | |
| Mapped Acceleration Parameter | (S_s) | 0.14 | Figures 22-1 Thru 22-14 |
| Mapped Acceleration Parameter | (S_1) | 0.07 | Figures 22-1 Thru 22-14 |
| Site Coefficient | (F_a) | 1 | |
| Site Coefficient | (F_v) | 1 | |
| MCE Spectral Resp. Accel. Short Per. | (S_{MS}) | 0.140 | |
| MCE Spectral Resp. Accel. 1-s Period | (S_{M1}) | 0.07 | |
| Design Spectral Accel. Short Period | (S_{DS}) | 0.093 | |
| Design Spectral Accel. 1-s Period | (S_{D1}) | 0.04667 | |
| Fundamental Period of Structure | (T_a) | 0.107 | sec |
| Long Period Transistion Period | (T_L) | 8 | sec Figure 22-15 Thru 22-20 |
| Seismic Design Category | - | A | |
| Total Effective Seismic Weight | (W_{eff}) | 12,866 | lbs |
| Response Modification Coefficient | (R) | 2 | Table 12.2-1 |
| System Overstrength Factor | (Ω_o) | 2.5 | Table 12.2-1 |
| Deflection Amplification Factor | (C_d) | 2 | Table 12.2-1 |
| Seismic Response Coefficient | (C_s) | 0.058 | |

Resultant Seismic Forces

| | | | |
|--------------------------------------|---|---------|---|
| Horizontal Seismic Load Effect | - | (E_h) | |
| Force at Base of Base | = | 0.1 | kips |
| Force at Top of Base | = | 0.1 | kips |
| Force at Top/Bottom of Enclosure | = | 0.01 | kips |
| Force on Silencer | = | 0 | kips |
| Vertical Seismic Load Effect (E_v) | = | 0 | (Factor, Used With Deadweight in Load Combinations) |

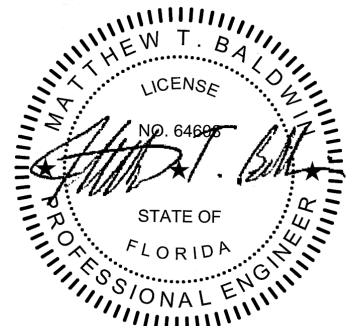

Matthew T. Baldwin, P.E.
Florida License #64608

Structural Calculations - Roof

Gillette 280" Frame Gensets

Critical Loads & Pressures

Wind Pressures

Downforce 1.86 psf = 0.01 psi
Uplift -115.1 psf = -0.80 psi

Snow Pressure

0 psf = 0.000 psi

Seismic Load

Horizontal = 10 lbs
Vertical Factor = 0

Roof Live Load

Downforce 20.0 psf = 0.1389 psi or 300 lbs Concentrated Load

Pressures & loads are the numerical maximums to be analyzed for shear, bending tension, and compression.

Section Properties

11 Gauge CRS

Cross Sectional Area (A) = 1.14 in²
Moment of Inertia - x (I_x) = 1.092 in⁴
Moment of Inertia - y (I_y) = N/A in⁴
Section Modulus - x (S_x) = 1.127 in³
Section Modulus - y (S_y) = N/A in³
Radius of Gyration - x (r_x) = 0.978 in
Radius of Gyration - y (r_y) = N/A in

Weight (w) = 0.120 lbs/in
Modulus of Elasticity (E) = 2.90E+04 ksi
Safety Factor (Ω) = 1.95
Plastic Section Mod. - x (Z_x) = 0.24
Plastic Section Mod. - y (Z_y) = 0.24
Tensile Ultimate Strength (F_{tu}) = 58 ksi
Tensile Yield Strength (F_{ty}) = 36 ksi
Compressive Yield Strength (F_{cy}) = 22 ksi
Shear Ultimate Strength (F_{su}) = 36 ksi

Roof Frame Calculations

Member Designed for Forces Acting on the **Strong Axis**


Interior Beam Critical Member Dimensions

Interior Beam Length (L_i) = 86 in
Load Spanned Width (W_i) = 36 in

Interior Beam Calculated Forces

Distributed Loads

Weight of Beam (w) = 0.029 lbs/in
Wind Load Downforce (w_d) = 0.465 lbs/in
Wind Load Uplift Force (w_u) = -28.765 lbs/in

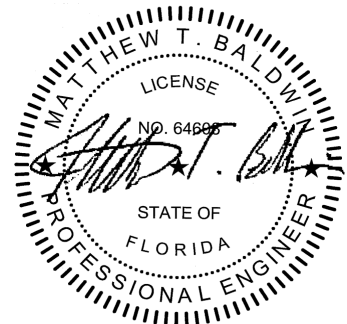

Matthew T. Baldwin, P.E.
Florida License #64608

Shear Forces (Maximum at End)

Beam Weight Shear (V_b) = 1.75 lbs
 Wind DownForce Shear (V_{wd}) = 9.7 lbs
 Wind Uplift Shear (V_{wu}) = -664.3 lbs

Total Shear Downward = 11.5 lbs
 Total Shear Upward = 662.5 lbs

Design Shear (V_{bi}) = 662.5 lbs

Stress Forces (Bending)

Beam Weight Moment (M_b) = 11 lb-in
 Wind Downforce Moment (M_d) = 47 lb-in
 Wind Uplift Moment (M_u) = -3,223 lb-in

Total Moments Downward = 59 lb-in
 Total Moments Upward = 3,211 lb-in

Design Moment (M_T) = 3,211 lb-in

Design Stress (σ_{bi}) = 8,921 psi

Interior Beam Design Calculations**Allowable Shear Strength**

Slenderness Limit 1 (S_1) = -20.08
 Slenderness Limit 2 (S_2) = 102.40
 Slenderness Ratio (S) = 18.0
 Allowable Shear Stress = 9,856 psi
 Allowable Shear Strength (V_n) = 3,548 lbs

Conclusion

(V_{bi}) 663 lbs < (V_n) 3,548 lbs **OK**

Allowable Stresses For Tension And Compression (Bending)**Tension**

Allowable Tensile Stress (F_t) = 54,778 psi


Compression

Slenderness Limit 1 (S_1) = 25.0
 Slenderness Limit 2 (S_2) = 125.0
 Slenderness Ratio (S) = 41.3
 Allowable Compressive Stress (F_c) = 13,121 psi

The Allowable Compressive Stress is the controlling failure design
 Therefore, (F_b) = 13,121 psi

Conclusion

(σ_{bi}) 8,921 psi < (F_b) 13,121 psi **OK**

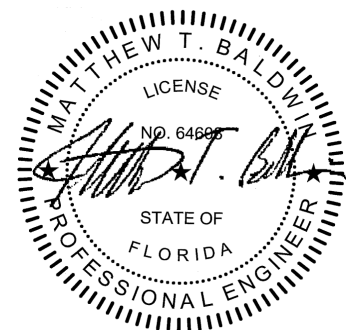

Matthew T. Baldwin, P.E.
 Florida License #64608

Entire Roof Uplift Calculations

Roof Area

Area of Roof Subjected to Uplift $(R) = 19,968 \text{ in}^2$ (not including discharge hood area)

Roof Uplift Calculated Forces

Roof Weight $(w_a) = 102 \text{ lbs}$

Wind Load Uplift Force $(w_{ru}) = -15,955 \text{ lbs}$

Total Roof Design Uplift $(W_{ru}) = -15,853 \text{ lbs}$

Mounting Hardware - Roof Frame to Wall Panels

Screws Along Length - 1 Side $= 18$ 5/16" - 18 Bolts

Screws Along Width - 1 Side $= 5$ 5/16" - 18 Bolts

Total Mounting Screws $= 46$ 5/16" - 18 Bolts

Entire Roof Uplift Design Calculations

Grade 18-8/SS Ult. Strength $= 150,000 \text{ psi}$

5/16" Bolt Nominal Diameter $= 0.255 \text{ in}$

5/16" Bolt Effective Area $= 0.051 \text{ in}^2$

5/16" Bolt Threads per Inch $= 18$

Washer Nominal Diameter $= 0.875 \text{ in}$

Wall Panel Tensile Ult. Strength $= 34 \text{ ksi}$

Wall Panel Tensile Yield Strength $= 26 \text{ ksi}$

Safety Factor $= 3$

Wall Panel Nominal Thickness $= 0.0800 \text{ in}$

Maximum Tensile Strength $= 566.7 \text{ lbs}$

Maximum Shear/Bearing Strength $= 408.6 \text{ lbs}$

Max. Tensile Load per Bolt $= 408.6 \text{ lbs}$

Max. Total Screws Tensile Strength $(P_{ts}) = 18,794 \text{ lbs}$

Conclusion

$(W_{ru}) \quad 15,853 \text{ lbs} < (P_{ts}) \quad 18,794 \text{ lbs} \quad \text{OK}$

Roof Panel Uplift Calculations

Roof Panel Critical Member Dimensions

Critical Panel Length $(L_p) = 72.00 \text{ in}$

Critical Panel Width $(W_p) = 96.00 \text{ in}$

Roof Panel Uplift Calculated Forces


Distributed Loads

Wind Load Uplift Force $(w_{pu}) = 5,522.9 \text{ lbs}$

Mounting Hardware - Roof Panel to Roof Frame

Screws Along Length - 1 Side $= 4$ 5/16" - 18 Bolts - Grade 18-8/SS

Screws Along Width - 1 Side $= 5$ 5/16" - 18 Bolts - Grade 18-8/SS

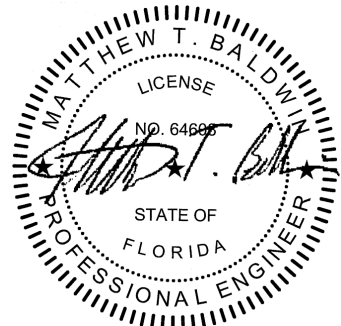

Matthew T. Baldwin, P.E.

Florida License #64608

Roof Panel Uplift Design Calculations


Grade 18-8/SS Ult. Strength = 150,000 psi
5/16" Bolt Nominal Diameter = 0.255 in
5/16" Bolt Effective Area = 0.051 in²
5/16" Bolt Threads per Inch = 18
Washer Nominal Diameter = 0.875 in
Roof Panel Tensile Ult. Strength = 34 ksi
Roof Panel Tensile Yield Strength = 26 ksi
Safety Factor = 3
Roof Panel Nominal Thickness = 0.1020 in

| | | | |
|--------------------------------|------------|-------|---|
| | Roof Frame | | (Accounts for screw pull-over and pull-out strengths) |
| Maximum Tensile Strength | = | 566.7 | |
| Maximum Shear/Bearing Strength | = | 408.6 | |
| Max. Tensile Load per Screw | = | 408.6 | |

Max. Total Screws Tensile Strength (P_{ts}) = 7,354 lbs

Conclusion

(w_{pu}) 5,523 lbs < (P_{ts}) 7,354 lbs **OK**

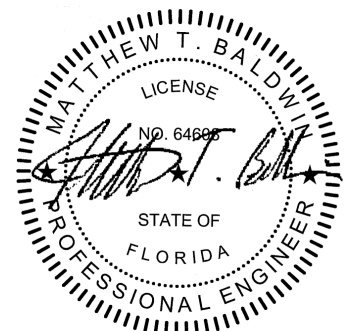

Matthew T. Baldwin, P.E.
Florida License #64608

Structural Calculations - Wall Panel

Gillette 280" Frame Gensets

Critical Loads & Pressures

Walls 1 & 2

Maximum Pressures Acting:

| | | | | | |
|--------|-------|-----|---|---------|-----|
| Toward | 93.4 | psf | = | 0.6488 | psi |
| Away | -84.1 | psf | = | -0.5838 | psi |

Walls 3 & 4

Maximum Pressures Acting:

| | | | | | |
|--------|-------|-----|---|---------|-----|
| Toward | 92.8 | psf | = | 0.6444 | psi |
| Away | -83.5 | psf | = | -0.5800 | psi |

Roof Forces on Critical Panel (From Roof Frame Calculations)

| | | | | |
|------------------------|------------|---|-------|-----|
| Maximum Downforce | (W_d) | = | 2,875 | lbs |
| Wind Load Uplift Force | (w_{pu}) | = | 5,523 | lbs |

Pressures and weights are the numerical maximums to be analyzed for shear, tension, and compression.

Critical Wall Panel Dimensions

| | | | |
|-------------------------------|---|-------|----|
| Critical/Maximum Panel Width | = | 90.00 | in |
| Critical/Maximum Panel Height | = | 56.00 | in |

Section Properties

0.102 Aluminum Panel - 5052-H34

| | | | | |
|----------------------------|------------|---|----------|---------------------|
| Cross Sectional Area | (A) | = | 5.71 | in ² |
| Moment of Inertia - x | (I_x) | = | 0.005 | in ⁴ |
| Moment of Inertia - y | (I_y) | = | N/A | in ⁴ |
| Section Modulus - x | (S_x) | = | 0.097 | in ³ |
| Section Modulus - y | (S_y) | = | N/A | in ³ |
| Radius of Gyration - x | (r_x) | = | 0.029 | in |
| Radius of Gyration - y | (r_y) | = | N/a | in |
| Weight | (w) | = | 0.026 | lbs/in ² |
| Modulus of Elasticity | (E) | = | 1.02E+04 | ksi |
| Safety Factor | (Ω) | = | 1.95 | |
| Plastic Section Mod. - x | (Z_x) | = | 0.13 | |
| Plastic Section Mod. - y | (Z_y) | = | 0.13 | |
| Tensile Ultimate Strength | (F_{tu}) | = | 34 | ksi |
| Tensile Yield Strength | (F_{ty}) | = | 26 | ksi |
| Compressive Yield Strength | (F_{cy}) | = | 24 | ksi |
| Shear Ultimate Strength | (F_{su}) | = | 20 | ksi |


Wall Panel Calculations

Critical Wall Area

| | | | | |
|--------------------|-------|---|---------|-----------------|
| Area of Wall Panel | (W) | = | 5,040.0 | in ² |
|--------------------|-------|---|---------|-----------------|

Mounting Hardware - Roof Frame to Wall Panels

| | | | |
|------------------------------|---|----|------------------|
| Screws Along Height - 1 Side | = | 4 | 5/16" - 18 Bolts |
| Screws Along Width - 1 Side | = | 3 | 5/16" - 18 Bolts |
| Total Mounting Screws | = | 14 | 5/16" - 18 Bolts |

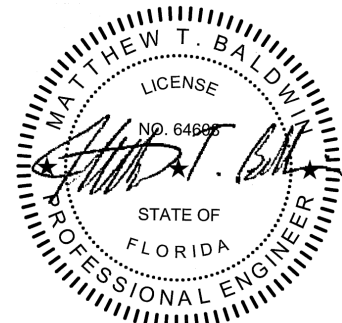

Matthew T. Baldwin, P.E.
Florida License #64608


Grade 5 Ultimate Strength = 150,000 psi
 5/16" Bolt Nominal Diameter = 0.255 in
 5/16" Bolt Effective Area = 0.051 in²
 5/16" Bolt Threads per Inch = 18
 Washer Nominal Diameter = 0.875 in
 Roof Panel Tensile Ult. Strength = 34 ksi
 Roof Panel Tensile Yield Strength = 26 ksi
 Safety Factor = 3
 Roof Panel Nominal Thickness = 0.1020 in

| | | | |
|--------------------------------|---|------------|---|
| | | Roof Frame | |
| Maximum Tensile Strength | = | 233.0 | (Accounts for screw pull-over and pull-out strengths) |
| Maximum Shear/Bearing Strength | = | 366.0 | |
| Max. Tensile Load per Bolt | = | 233.0 | |

Max. Total Screws Tensile Strength (P_{ts}) = 3,562 lbs

Conclusion

(w_{pu}) 3,270 lbs < (P_{ts}) 3,562 lbs **OK**

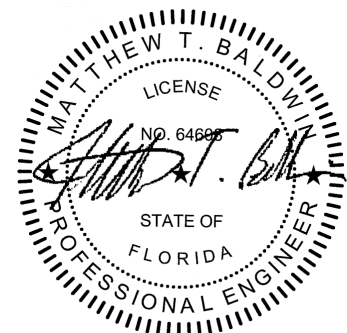

Matthew T. Baldwin, P.E.
Florida License #64608

Structural Calculations - Enclosure to Base

Gillette 280" Frame Gensets

Critical Pressures & Loads

To determine maximum moment forces, pressures are algebraically combined relative to toward or away forces (+ & -) and each wind direction.

Wind Direction 1

To be conservative, roof downforce is neglected.

Net Pressures with + Internal Pressure(+Gcpi)

| | | | | | |
|-------------|---|-------|-------|--------|-----|
| Walls 1 & 2 | - | 98.6 | psf = | 0.6850 | psi |
| Wall 3 or 4 | - | 83.5 | psf = | 0.5800 | psi |
| Roof Uplift | - | 102.8 | psf = | 0.7138 | psi |

Net Pressures with - Internal Pressure(-Gcpi)

| | | | | | |
|-------------|---|------|-------|--------|-----|
| Walls 1 & 2 | - | 98.6 | psf = | 0.6850 | psi |
| Wall 3 or 4 | - | 46.4 | psf = | 0.3221 | psi |
| Roof Uplift | - | 65.7 | psf = | 0.4560 | psi |

Wind Direction 2

Net Pressures with + Internal Pressure(+Gcpi)

| | | | | | |
|-------------|---|-------|-------|--------|-----|
| Walls 3 & 4 | - | 120.6 | psf = | 0.8377 | psi |
| Wall 1 or 2 | - | 84.1 | psf = | 0.5838 | psi |
| Roof Uplift | - | 115.1 | psf = | 0.7990 | psi |

Net Pressures with - Internal Pressure(-Gcpi)

| | | | | | |
|-------------|---|-------|-------|--------|-----|
| Walls 3 & 4 | - | 120.6 | psf = | 0.8377 | psi |
| Wall 1 or 2 | - | 46.9 | psf = | 0.3260 | psi |
| Roof Uplift | - | 77.9 | psf = | 0.5412 | psi |

Seismic

Horizontal Seismic Force (E_h) = 10 lbs

Enclosure Critical Dimensions & Weights

| | | | | | |
|------------------------|-------------------|------|---------|---------|---------------------------|
| Total Enclosure Weight | (W _t) | = | 8,500.0 | lbs | (Includes all components) |
| Walls 1/2 Area | - | (w1) | = | 11596.8 | in ² |
| Walls 3/4 Area | - | (w3) | = | 33823.5 | in ² |
| Roof Area | - | (R) | = | 26879.6 | in ² |


Enclosure Calculated Forces

Maximum Wind Load Forces on Walls

Wind Direction 1

Net Forces with + Internal Pressure(+Gcpi)

| | | | | |
|-------------|---|---|--------|-----|
| Walls 1/2 | - | = | 7,944 | lbs |
| Wall 3 or 4 | - | = | 19,616 | lbs |
| Roof Uplift | - | = | 19,186 | lbs |

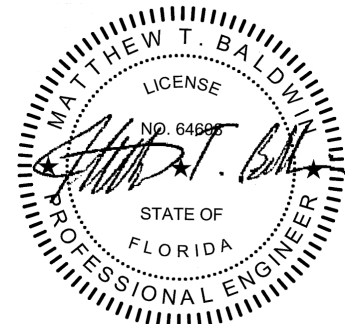

Matthew T. Baldwin, P.E.
Florida License #64608

Net Forces with - Internal Pressure(-Gcpi)

| | | | | |
|-------------|---|---|--------|-----|
| Walls 1/2 | - | = | 7,944 | lbs |
| Wall 3 or 4 | - | = | 10,896 | lbs |
| Roof Uplift | - | = | 12,256 | lbs |

Wind Direction 2**Net Forces with + Internal Pressure(+Gcpi)**

| | | | | |
|-------------|---|---|--------|-----|
| Walls 3/4 | - | = | 28,333 | lbs |
| Wall 1 or 2 | - | = | 6,770 | lbs |
| Roof Uplift | - | = | 21,478 | lbs |

Net Forces with - Internal Pressure(-Gcpi)

| | | | | |
|-------------|---|---|--------|-----|
| Walls 3/4 | - | = | 28,333 | lbs |
| Wall 1 or 2 | - | = | 3,780 | lbs |
| Roof Uplift | - | = | 14,548 | lbs |

Enclosure Overturn Forces (Includes Seismic)

(Postive forces act upward, negative forces act downward)

Wind Direction 1**Net Forces with + Internal Pressure(+Gcpi)**

| | | | |
|-----------------------|---|--------|-----|
| Overturn on Walls 1/2 | = | 7,057 | lbs |
| Overturn on Walls 3/4 | = | 17,685 | lbs |

Net Forces with - Internal Pressure(-Gcpi)

| | | | |
|-----------------------|---|-------|-----|
| Overturn on Walls 1/2 | = | 3,592 | lbs |
| Overturn on Walls 3/4 | = | 8,734 | lbs |

Wind Direction 2**Net Forces with + Internal Pressure(+Gcpi)**

| | | | |
|-----------------------|---|--------|-----|
| Overturn on Walls 3/4 | = | 24,315 | lbs |
| Overturn on Walls 1/2 | = | 7,949 | lbs |

Net Forces with - Internal Pressure(-Gcpi)

| | | | |
|-----------------------|---|--------|-----|
| Overturn on Walls 3/4 | = | 20,850 | lbs |
| Overturn on Walls 1/2 | = | 3,840 | lbs |

Design Overturn Force (O_E) = 24,315 lbs Acting On Wall 3/4

Mounting Hardware - Enclosure to Base/Tank or Pad

To be conservative, bolt connections along the adjacent walls are neglected.

No. of Bolt Connections Along Wall 3/4 = 11 5/16" - 18 Bolts - Grade 18-8/S


Enclosure Overturn Design Calculations

| | | | | |
|-------------------------------|---|---------|-----------------|-----------------------------|
| Grade 18-8 Ultimate Strength | = | 150,000 | psi | |
| Grade 8.8 Nom. Tensile Stress | = | 112,500 | psi | (Includes Reduction Factor) |
| 5/16" Bolt Effective Area | = | 0.051 | in ² | |
| Tensile Strength per Bolt | = | 2,873 | lbs | |

Total Bolts Tensile Strength = 31,600 lbs

Conclusion

(O_E) 24,315 lbs < (R_v) 31,600 lbs **OK**

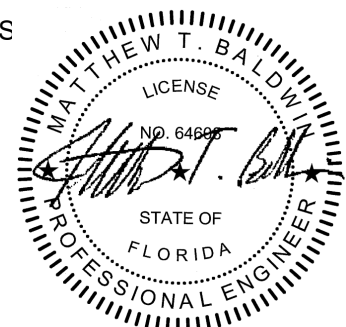

Matthew T. Baldwin, P.E.
Florida License #64608

Structural Calculations - Enclosure With Base/Tank to Pad

Gillette 280" Frame Gensets

Critical Wind Load Pressures

To determine maximum moment forces, pressures are algebraically combined relative to toward or away forces (+ & -) and each wind direction.

Wind Direction 1

To be conservative, roof downforce is neglected.

Net Pressures with + Internal Pressure(+G_{cpi})

| | | | | | |
|-------------|---|-------|-------|--------|-----|
| Walls 1 & 2 | - | 98.6 | psf = | 0.6850 | psi |
| Wall 3 or 4 | - | 83.5 | psf = | 0.5800 | psi |
| Roof Uplift | - | 102.8 | psf = | 0.7138 | psi |

Net Pressures with - Internal Pressure(-G_{cpi})

| | | | | | |
|-------------|---|------|-------|--------|-----|
| Walls 1 & 2 | - | 98.6 | psf = | 0.6850 | psi |
| Wall 3 or 4 | - | 46.4 | psf = | 0.3221 | psi |
| Roof Uplift | - | 65.7 | psf = | 0.4560 | psi |

Wind Direction 2

Net Pressures with + Internal Pressure(+G_{cpi})

| | | | | | |
|-------------|---|-------|-------|--------|-----|
| Walls 3 & 4 | - | 120.6 | psf = | 0.8377 | psi |
| Wall 1 or 2 | - | 84.1 | psf = | 0.5838 | psi |
| Roof Uplift | - | 115.1 | psf = | 0.7990 | psi |

Net Pressures with - Internal Pressure(-G_{cpi})

| | | | | | |
|-------------|---|-------|-------|--------|-----|
| Walls 3 & 4 | - | 120.6 | psf = | 0.8377 | psi |
| Wall 1 or 2 | - | 46.9 | psf = | 0.3260 | psi |
| Roof Uplift | - | 77.9 | psf = | 0.5412 | psi |

Seismic

Enclosure Horiz. Seismic Force (E_{Eh}) = 10 lbs

Base/Tank Horiz. Seismic Force (E_{Bh}) = 129 lbs

Enclosure With Base/Tank Critical Dimensions & Weights

| | | | | | |
|------------------------|--------------------|---|--------|-----------------|-----------------------------------|
| Total Enclosure Weight | (W _t) | = | 8,950 | lbs | (Includes all components) |
| Walls 1/2 Area | -(w ₁) | = | 12,365 | in ² | (Includes Base/Tank Surface Area) |
| Walls 3/4 Area | -(w ₃) | = | 36,064 | in ² | (Includes Base/Tank Surface Area) |
| Roof Area | -(R) | = | 26,880 | in ² | |


Enclosure With Base/Tank Calculated Forces

Maximum Wind Shear Forces on Walls Including Base/Tank

Wind Direction 1

Net Forces with + Internal Pressure(+G_{cpi})

| | | | | |
|-------------|---|---|--------|-----|
| Walls 1/2 | - | = | 8,470 | lbs |
| Wall 3 or 4 | - | = | 20,915 | lbs |
| Roof Uplift | - | = | 19,186 | lbs |

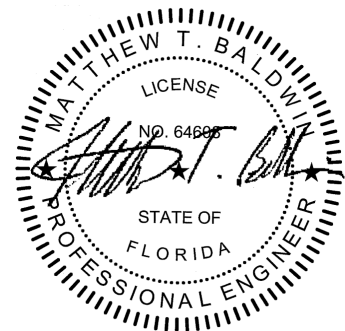

Matthew T. Baldwin, P.E.
Florida License #64608

Net Forces with - Internal Pressure(-Gcpi)

| | | | | |
|-------------|---|---|--------|-----|
| Walls 1/2 | - | = | 8,470 | lbs |
| Wall 3 or 4 | - | = | 11,618 | lbs |
| Roof Uplift | - | = | 12,256 | lbs |

Wind Direction 2**Net Forces with + Internal Pressure(+Gcpi)**

| | | | | |
|-------------|---|---|--------|-----|
| Walls 3/4 | - | = | 29,001 | lbs |
| Wall 1 or 2 | - | = | 7,219 | lbs |
| Roof Uplift | - | = | 21,478 | lbs |

Net Forces with - Internal Pressure(-Gcpi)

| | | | | |
|-------------|---|---|--------|-----|
| Walls 3/4 | - | = | 29,001 | lbs |
| Wall 1 or 2 | - | = | 4,031 | lbs |
| Roof Uplift | - | = | 14,548 | lbs |

Enclosure with Base/Tank Maximum Wind Force = 29,001 lbs Acting On Wall 3/4

Coefficient of Friction - Steel to Wet Concrete (μ_s) = 0.45

Frictional Resisting Force (Total Weight x μ_s) = 4,028

Enclosure with Base/Tank Design Shear (V_{EB}) = 24,973

Enclosure With Base/Tank Overturn Forces (Includes Seismic)

Postive forces act upward

Wind Direction 1**Net Forces with + Internal Pressure(+Gcpi)**

| | | | |
|-----------------------|---|--------|-----|
| Overturn on Walls 1/2 | = | 7,074 | lbs |
| Overturn on Walls 3/4 | = | 19,173 | lbs |

Net Forces with - Internal Pressure(-Gcpi)

| | | | |
|-----------------------|---|-------|-----|
| Overturn on Walls 1/2 | = | 3,610 | lbs |
| Overturn on Walls 3/4 | = | 9,471 | lbs |


Wind Direction 2**Net Forces with + Internal Pressure(+Gcpi)**

| | | | |
|-----------------------|---|--------|-----|
| Overturn on Walls 3/4 | = | 25,743 | lbs |
| Overturn on Walls 1/2 | = | 7,932 | lbs |

Net Forces with - Internal Pressure(-Gcpi)

| | | | |
|-----------------------|---|--------|-----|
| Overturn on Walls 3/4 | = | 22,278 | lbs |
| Overturn on Walls 1/2 | = | 3,734 | lbs |

Design Overturn Force (O_{EB}) = 25,743 lbs Acting On Wall 3/4

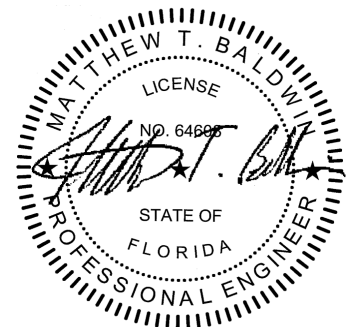

Matthew T. Baldwin, P.E.
Florida License #64608

Mounting Hardware - Enclosure With Base/Tank to Pad

No. of Bolt Connections Along Wall 3/4 = 6 Bolts 1/2" Set Bolt Anchors - Grade 5/Galv.

Enclosure With Base/Tank Design Calculations

Mounting Hardware - Shear and Tension

Grade 5 Ultimate Stress = 120,000 psi
Grade 5 Nom. Shear Stress = 48,000 psi
Grade 5 Nom. Tensile Stress = 90,000 psi
1/2" Bolt Nominal Area = 0.159 in²
Shear Strength per Bolt = 4,198 lbs
Tensile Strength per Bolt = 7,155 lbs

Total Bolts Shear Strength (R_{vb}) = 25,186 lbs
Total Bolts Tensile Strength (R_{tb}) = 42,930 lbs


Conclusion

Shear

(V_{EB}) 24,973 lbs < (R_{tb}) 25,186 lbs **OK**

Tension

(O_{EB}) 25,743 lbs < (R_{tb}) 42,930 lbs **OK**

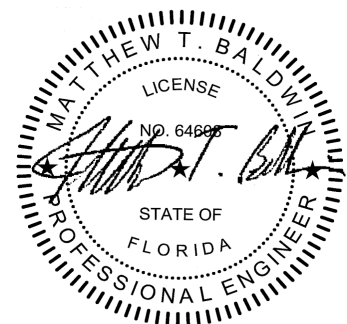

Matthew T. Baldwin, P.E.
Florida License #64608